Drawing number / Rev

B1297000-PH2/3000.01a/0035 R2

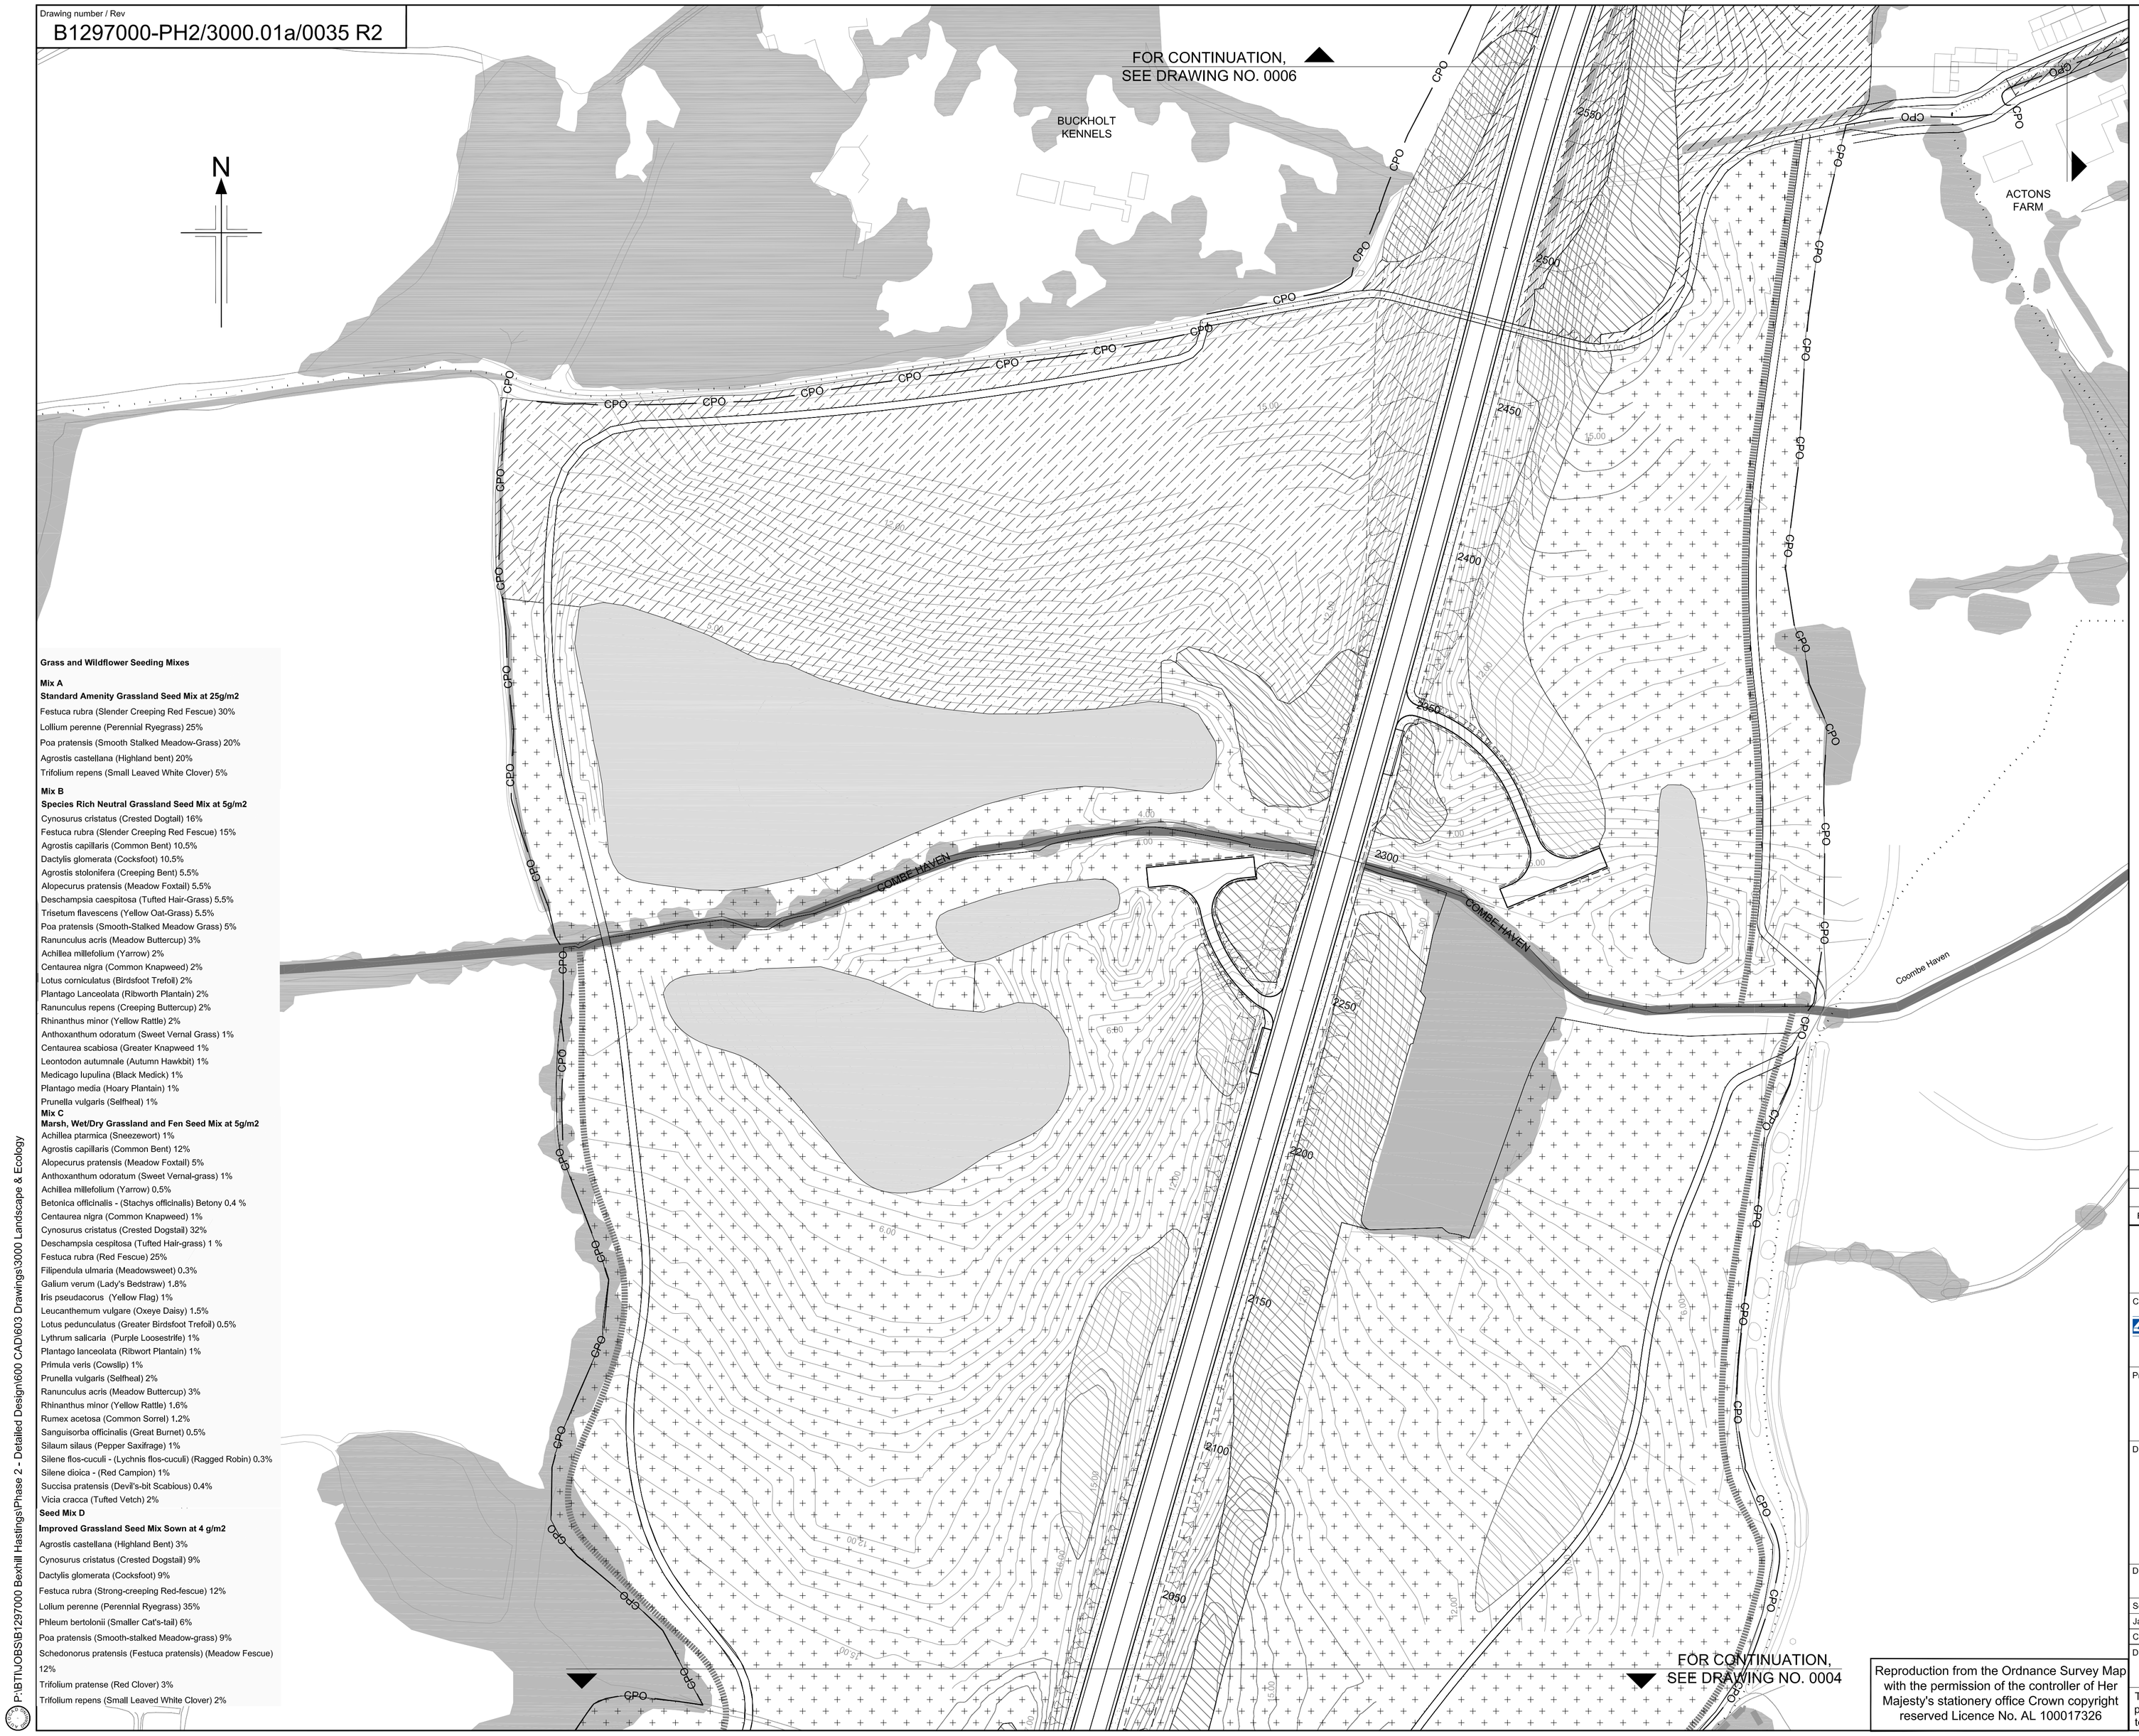


**Grass and Wildflower Seeding Mixes**

**Mix A**
**Standard Amenity Grassland Seed Mix at 25g/m2**
Festuca rubra (Slender Creeping Red Fescue) 30%
Lollium perenne (Perennial Ryegrass) 25%
Poa pratensis (Smooth Stalked Meadow-Grass) 20%
Agrostis castellana (Highland bent) 20%
Trifolium repens (Small Leaved White Clover) 5%

**Mix B**
**Species Rich Neutral Grassland Seed Mix at 5g/m2**
Cynosurus cristatus (Crested Dogtail) 16%
Festuca rubra (Slender Creeping Red Fescue) 15%
Agrostis capillaris (Common Bent) 10.5%
Dactylis glomerata (Cocksfoot) 10.5%
Agrostis stolonifera (Creeping Bent) 5.5%
Alopecurus pratensis (Meadow Foxtail) 5.5%
Deschampsia caespitosa (Tufted Hair-Grass) 5.5%
Trisetum flavescens (Yellow Oat-Grass) 5.5%
Poa pratensis (Smooth-Stalked Meadow Grass) 5%
Ranunculus acris (Meadow Buttercup) 3%
Achillea millefolium (Yarrow) 2%
Centaurea nigra (Common Knapweed) 2%
Lotus corniculatus (Birdsfoot Trefoil) 2%
Plantago Lanceolata (Ribworth Plantain) 2%
Ranunculus repens (Creeping Buttercup) 2%
Rhinanthus minor (Yellow Rattle) 2%
Anthoxanthum odoratum (Sweet Vernal Grass) 1%
Centaurea scabiosa (Greater Knapweed 1%
Leontodon autumnale (Autumn Hawkbit) 1%
Medicago lupulina (Black Medick) 1%
Plantago media (Hoary Plantain) 1%
Prunella vulgaris (Selfheal) 1%

**Mix C**
**Marsh, Wet/Dry Grassland and Fen Seed Mix at 5g/m2**
Achillea ptarmica (Sneezewort) 1%
Agrostis capillaris (Common Bent) 12%
Alopecurus pratensis (Meadow Foxtail) 5%
Anthoxanthum odoratum (Sweet Vernal-grass) 1%
Achillea millefolium (Yarrow) 0.5%
Betonica officinalis - (Stachys officinalis) Betony 0.4 %
Centaurea nigra (Common Knapweed) 1%
Cynosurus cristatus (Crested Dogstail) 32%
Deschampsia cespitosa (Tufted Hair-grass) 1 %
Festuca rubra (Red Fescue) 25%
Filipendula ulmaria (Meadowsweet) 0.3%
Galium verum (Lady's Bedstraw) 1.8%
Iris pseudacorus (Yellow Flag) 1%
Leucanthemum vulgare (Oxeye Daisy) 1.5%
Lotus pedunculatus (Greater Birdsfoot Trefoil) 0.5%
Lythrum salicaria (Purple Loosestrife) 1%
Plantago lanceolata (Ribwort Plantain) 1%
Primula veris (Cowslip) 1%
Prunella vulgaris (Selfheal) 2%
Ranunculus acris (Meadow Buttercup) 3%
Rhinanthus minor (Yellow Rattle) 1.6%
Rumex acetosa (Common Sorrel) 1.2%
Sanguisorba officinalis (Great Burnet) 0.5%
Silaum silaus (Pepper Saxifrage) 1%
Silene flos-cuculi - (Lychnis flos-cuculi) (Ragged Robin) 0.3%
Silene dioica - (Red Campion) 1%
Succisa pratensis (Devil's-bit Scabious) 0.4%
Vicia cracca (Tufted Vetch) 2%

**Seed Mix D**
**Improved Grassland Seed Mix Sown at 4 g/m2**
Agrostis castellana (Highland Bent) 3%
Cynosurus cristatus (Crested Dogstail) 9%
Dactylis glomerata (Cocksfoot) 9%
Festuca rubra (Strong-creeping Red-fescue) 12%
Lolium perenne (Perennial Ryegrass) 35%
Phleum bertolonii (Smaller Cat's-tail) 6%
Poa pratensis (Smooth-stalked Meadow-grass) 9%
Schedonorus pratensis (Festuca pratensis) (Meadow Fescue) 12%
Trifolium pratense (Red Clover) 3%
Trifolium repens (Small Leaved White Clover) 2%

P:\BTI\JOBS\B1297000 Bexhill Hastings\Phase 2 - Detailed Design\600 CAD\603 Drawings\3000 Landscape & Ecology

## NOTES

1. All dimensions in metres unless otherwise stated.

## KEY

- Mix A (Standard amenity grass seed mix)
- Mix D (Arable)
- Mix B (Species rich neutral grassland)
- Mix B (Open grassland suitable for badger foraging)
- Mix C (Marsh, wet grassland and fen)
- Mix D (Improved grassland )
- 75mm deep composted bark mulch
- Site of Special Scientific Interest (SSSI)
- Site of Nature Conservation Importance (SNCI)
- Ditch
- Watercourse
- Pond
- Public Footpath
- Byway
- Bridleway
- Existing trees, hedges & scrub to be retained
- Finished ground within planting plots but outside the specified weedfree zones at each planting station to be left unseeded but to be strimmed at least 3 times during each growing season to control the natural colonisation of herbaceous vegetation.

| SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION |
|---|
| In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following : |
| CONSTRUCTION<br>Likelihood of fly-tipped hazardous substances<br>Existing overhead and underground high voltage cables<br>Working adjacent to a railway<br>Working on slopes steeper than 1:3<br>Working near to site plant and other machinery |
| MAINTENANCE / CLEANING<br>Same as for construction |
| DECOMMISSIONING / DEMOLITION<br>Same as for construction |
| It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement |

0 10 20 30 40 50 60 70 80 90 100 m

SCALE 1 : 1000

| Rev | Rev. Date | Purpose of revision | Drawn | Checkd | Rev'd | Apprv'd |
|---|---|---|---|---|---|---|
| R2 | 08/01/2013 | PLANTATION SEEDING REMOVED | EH | AS | AS | AB |
| R1 | 13/12/2012 | CHANGES TO SEED MIXES | AS | ES | ES | AB |
| R0 | 15/10/2012 | INITIAL ISSUE | RM | ES | AS | AB |


JACOBS
Simpson House, 6 Cherry Orchard Road, Croydon, Surrey, CR9 6BE
Tel:+44(0)208 686 8212 Fax:+44(0) 208 681 2499
www.jacobs.com


Client: HOCHTIEF AMEC CONSTRUCTION; TAYLOR WOODROW

Employer: East Sussex County Council, eastsussex.gov.uk

Project

BEXHILL TO HASTINGS LINK ROAD

Drawing title

SEEDING
SHEET 5 OF 13

Drawing status

ISSUE FOR REVIEW

| | | |
|---|---|---|
| Scale | 1:1000 @ A1 | DO NOT SCALE |
| Jacobs No. | B1297000 | |
| Client no. | | |

Drawing number: B1297000-PH2/3000.01a/0035 Rev: R2


Reproduction from the Ordnance Survey Map with the permission of the controller of Her Majesty's stationery office Crown copyright reserved Licence No. AL 100017326

This drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.