


**FOR CONTINUATION -  
 SEE DRAWING NO. 0002**

- NOTES**
- Column door locks to be greased.
  - Street lighting columns and lit sign units (unless located on island) to have individual connections to the DNO network and to be sub-used by the use of a Charles Endrick secondary double pole isolator (S02 SF fitted with 6A HRC fuse. Double arm columns to have two HRC fuses
  - Where a new or existing street lighting column has an outgoing cable, it shall be protected by a double pole isolator unit incorporating an additional 16A HRC fuse to protect the outgoing circuit.
  - Internal column wiring to be BICC 1.5 sq mm/2.5 sq mm live and neutral with earth conductor PVC/PVC insulation. Earth block to be provided and the main earth bond to be 10 sq mm. Column door to be bonded in 6 sq mm flexible cable and connected to the earth block.
  - Column reference numbers to be as advised by ESCC and HA.
  - HA column EX02 believed to be fed from feeder pillar EXFP903. Contractor to determine on site prior to disconnection and removal of column.
  - Contractor to trace and locate/determine existing supplies to bollards on islands being removed.
  - ESCC lighting columns to comply with the requirements in ESCC Lighting Specification document.
  - For Chapel Path subway design refer to Drawing No. B1297001-PH2/1300.01A/0006.

- KEY**
- Existing HA feeder pillar to remain.
  - Existing ESCC 8m road lighting column to remain.
  - Existing HA 10m road lighting column to remain.
  - Existing HA 10m double arm road lighting column to be taken up or down and removed to tip off site.
  - Existing bollard to be taken up or down and removed to tip off site.
  - Existing ESCC road lighting column to be taken up or down and removed to tip off site.
  - Existing Balisra Beacon to be taken up or down and removed to tip off site.
  - Existing 8m road lighting column to have luminaire replaced with Urbis Tecco 2 flat glass luminaire with grey painted aluminium canopy, 4250 Kelvin neutral white colour temperature with 5088-104 LED's fitted with Zodion one part Rolalok fitting set to 35 lux.
  - Proposed ALC LTD Tapered Post Top Aluminium road lighting column of 8m nominal height standard reinforcement tube thermoplastic root protection brushed finish to BS EN 40 with Urbis Tecco 2 flat glass luminaire with grey painted aluminium canopy, 4250 Kelvin neutral white colour temperature with 5088-104 LED's fitted with Zodion one part Rolalok fitting set to 35 lux.
  - Proposed ALC LTD Tapered Post Top Aluminium road lighting column of 10m nominal height standard reinforcement tube thermoplastic root protection brushed finish to BS EN 40 with Urbis Tecco 2 flat glass luminaire with grey painted aluminium canopy, 4250 Kelvin neutral white colour temperature with 5088-104 LED's fitted with Zodion one part Rolalok fitting set to 35 lux.
  - Proposed Stanton galvanised tubular steel double arm road lighting column of 10m nominal height with 2 x 0.5m projection brackets with WRT1 ARC 90 flat glass luminaires (AMRS02N2/D/L) and 150W SON-T lamps.
  - Proposed Giesdon Rebound Signmaster LED bollard (as HA spec).
  - Proposed 6mm sq 3 core XLPE/PVC/SWAPVC cable in 2x100mm dia orange UPVC duct.
  - Proposed access chamber Type B.
  - Proposed ALC LTD Hinged Central Post Top Aluminium road lighting column of 5m nominal height standard reinforcement tube thermoplastic root protection brushed finish to BS EN 40 with Urbis Kic luminaire 5088 321721 with 32 LED's fitted with Zodion one part Rolalok fitting set to 35 lux.
  - Road crossing duct.

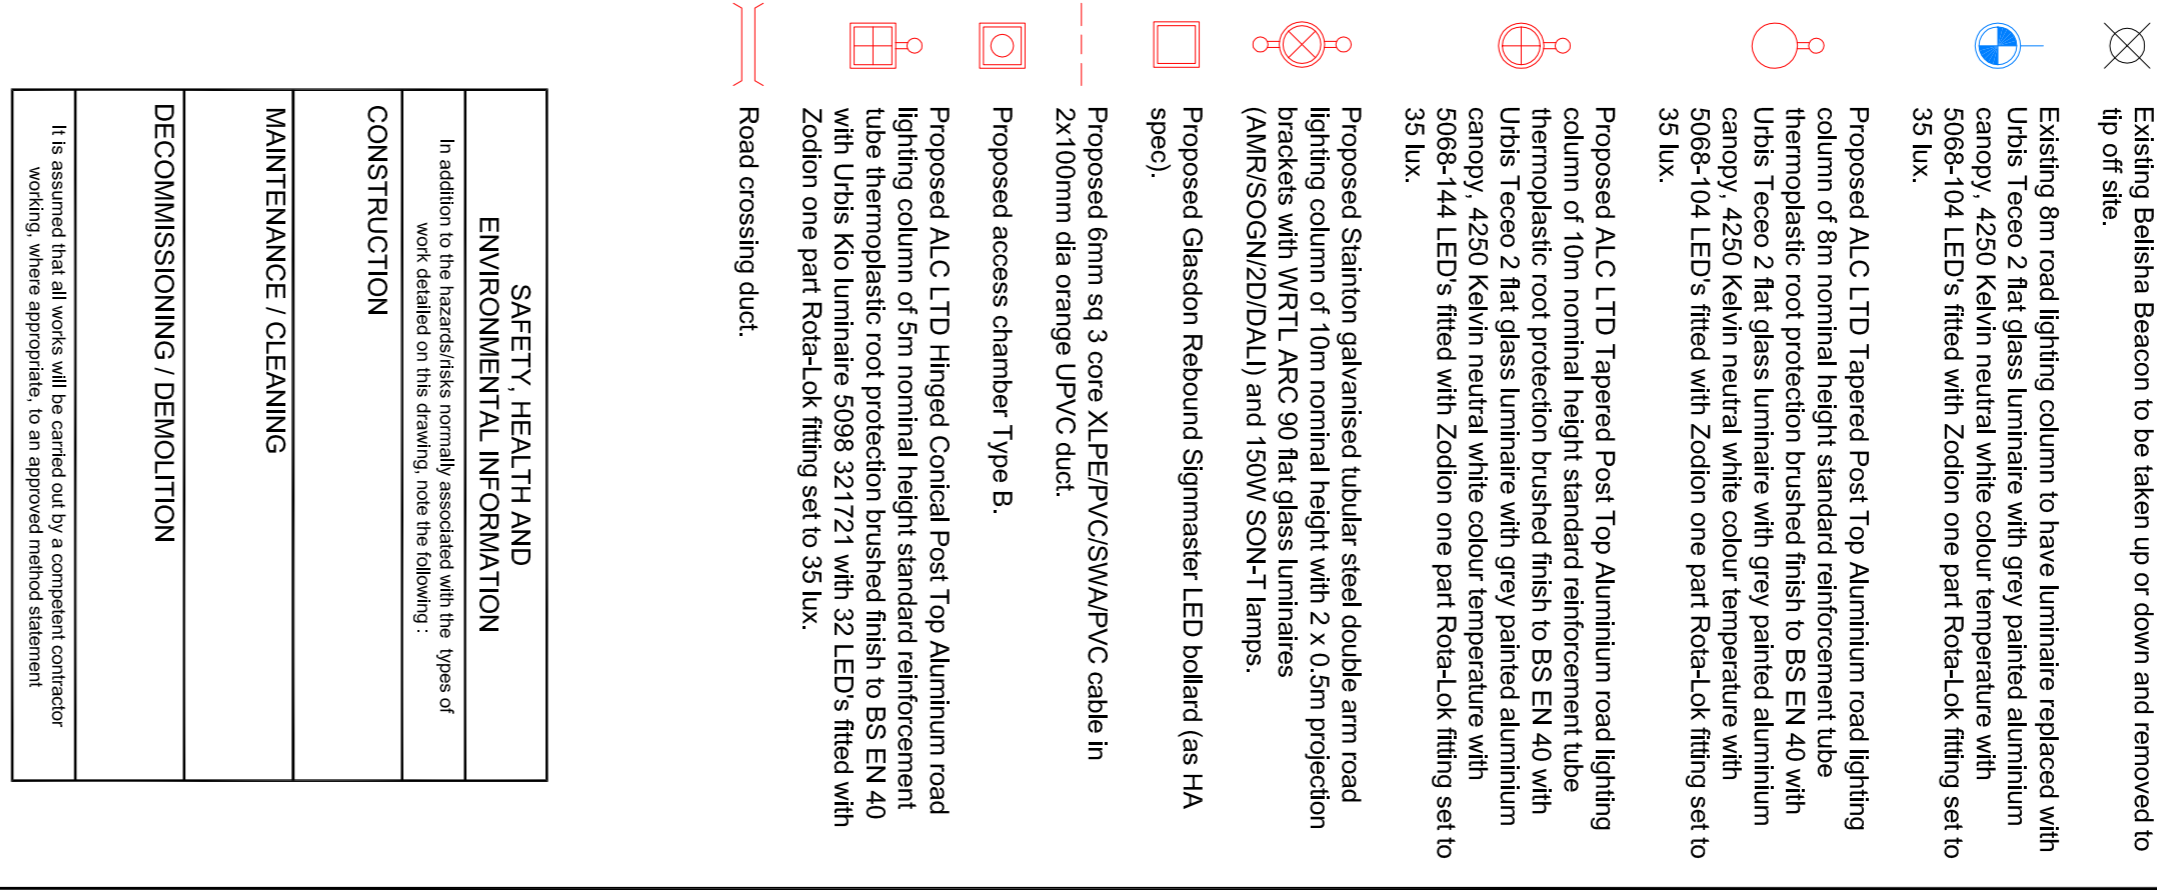

**SAFETY, HEALTH AND ENVIRONMENTAL INFORMATION**  
 In addition to the hazards/risks normally associated with the types of work detailed on this drawing, refer to the following:

**CONSTRUCTION**

**MAINTENANCE / CLEANING**

**DECOMMISSIONING / DEMOLITION**

It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement.

**JACOBS**  
 Simpson House, 6 Champ Ground Road, Gosport, Surrey, CR8 6BE  
 Tel: +44(0)2081 666 8212 Fax: +44(0)2081 2459  
 www.jacobs.com

**Client**  
**HOCHTIEF**  
 INFRASTRUCTURE

**Employer**  
**TESSER**  
 WATERWAYS

**Project**  
**BEXHILL TO HASTINGS LINK ROAD**

**Drawing title**  
**STREET LIGHTING  
 BELLE HILL JUNCTION  
 SHEET 1 OF 5**

**Drawing status**  
**ISSUE FOR REVIEW**

**Scale**  
 1:500 @ A1  
**DO NOT SCALE**

**Jacobs No.**  
 B1297000-PH2

**Client no.**  
 B1297000-PH2

**Drawing number**  
**B1297000-PH2/1300.01a/0001**

**Rev**  
**R0**

This drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.